


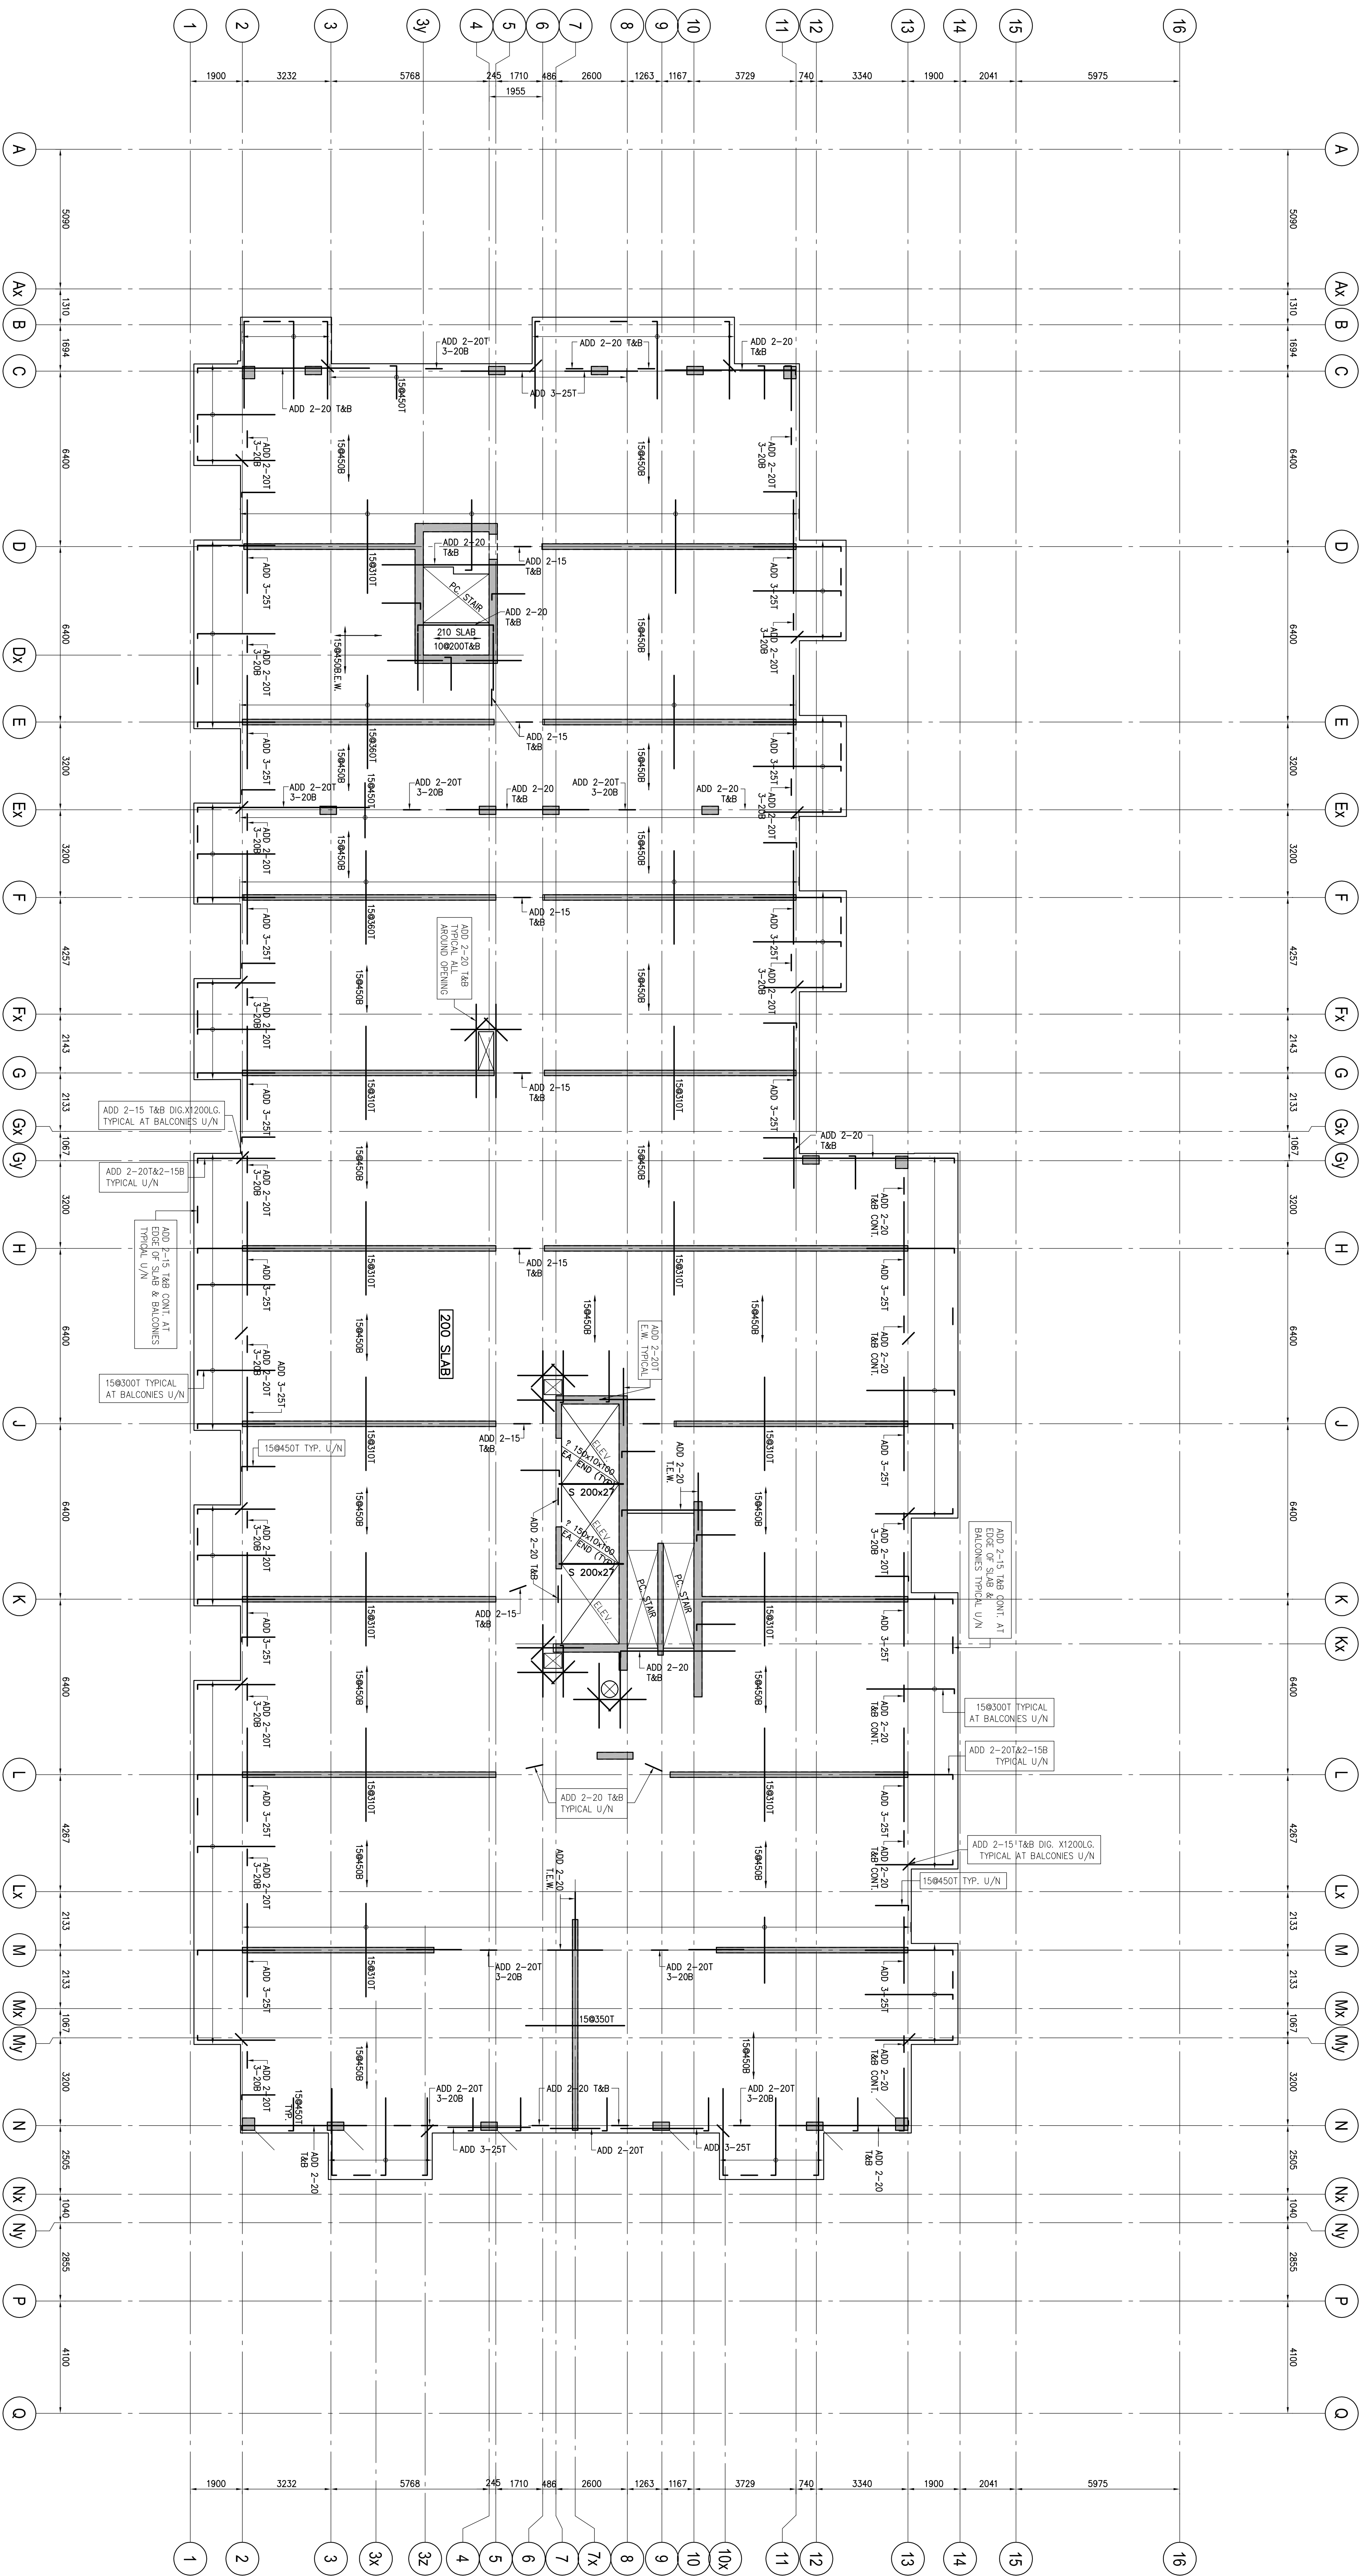

8TH FLOOR FRAMING PLAN

SCALE 1 : 100

1. TOP OF SLAB IS AT ELEVATION AS SHOWN ON ARCH. DRAWINGS EXCEPT AS CROSSED AND NOTED ON PLAN.
2. CONCRETE STRENGTH AT 28 DAYS SHALL BE:
FOR WALLS AND COLUMNS 35 MPa
FOR EXT. SLABS 35 MPa
FOR BEAMS 35 MPa
CONCRETE EXPOSED TO ELEMENTS SHALL BE 35 MPa WITH 6% TO 8% ENHANCED AIR.
3. FLOOR SLABS ARE DESIGNED FOR FOLLOWING LOADING CONDITIONS :

	S.L.D.	L.L.
STAIRS & BALCONIES	0.50 kPa	4.80 kPa
LOBBIES & STORAGE	1.50 kPa	4.80 kPa
RESIDENTIAL	1.50 kPa	1.9 kPa
TOILETS	1.50 kPa	2.40 kPa
TERACES	5.0 kPa	4.80 kPa
4. MINIMUM YIELD STRESS FOR REINFORCING STEEL SHALL BE 400 MPa.
5. TEMPERATURE REINFORCING FOR - 200 SLAB IS 10M250.
6. NO OPENINGS LARGER THAN 300mm x 300mm ARE ALLOWED IN SLAB OTHER THAN THOSE SHOWN ON DRAWINGS.
7. SEE GENERAL DETAILS ON DRAWINGS S-001 TO S-006.
8. SEE GENERAL NOTES ON DRAWINGS S-001.
9. REFER TO ARCH. DRAWINGS FOR SLOPES OF SLAB.
10. FOR COLUMN & WALL SCHEDULE SEE DRAWINGS S-001 TO S-006.
11. CORROSION BEAM DEPTH AT DOOR OPENINGS WITH ARCH. DRAWINGS.
12. EXTEND TEMP. REINFC. TO END OF BALCONIES/OPENINGS.
13. TOP BARS TERMINATING AT EDGE OF SLAB TO HAVE 180° HOOK.

DIRECTION OF REINFORCING OF THE SLAB
UNLESS DRAWN ON THE PLAN