


10TH FLOOR FRAMING PLAN
SCALE: 1:100

1. TOP OF SLAB IS AT ELEVATION AS SHOWN ON ARCH. DRAWINGS EXCEPT AS NOTED ON PLAN.
2. CONCRETE STRENGTH AT 28 DAYS SHALL BE: FOR WALLS AND COLUMNS SEE SCHEDULE FOR WALLS AND COLUMNS FOR INTERIOR SLABS 25 MPa FOR BEAMS 30 MPa CONCRETE EXPOSED TO ELEMENTS SHALL BE 35 MPa WITH 6% TO BE ENTRAINED AIR.
3. FLOOR SLABS ARE DESIGNED FOR FOLLOWING LOADING CONDITIONS:

	S.L.D.	L.L.
STAIRS & BALCONIES	0.50 kPa	4.80 kPa
LOCKERS & STORAGE	1.30 kPa	4.80 kPa
RESIDENTIAL	1.30 kPa	2.40 kPa
TOILETS	1.30 kPa	2.40 kPa
TERRACES	5.0 kPa	4.80 kPa

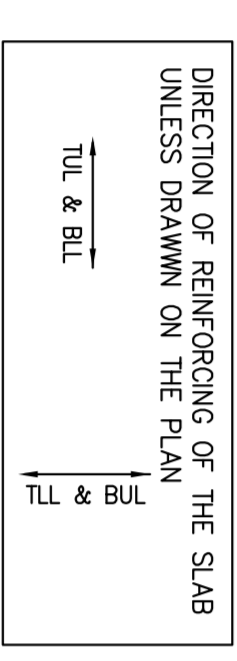


10TH FLOOR BEAM SCHEDULE (f_c' = 35MPa)

MARK	WIDTH	DEPTH	REINFORCEMENT		STIRRUPS		REMARKS
			BOTTOM CONT.	TOP CONT.	SIZE	EACH END	
BM-1	700	500	2-15, 2-20	5-20	15	19100, 69200, 9235	ADD 1-15HF
BM-2	700	500	2-15, 2-20	5-20	15	19100, 69200, 9235	ADD 1-15HF
BM-3	900	600	2-15, 2-20	5-25	15	19855, 9170	ADD 1-15HF
BM-4	900	600	2-15, 2-20	5-25	15	19855, 9170	ADD 1-15HF

FIRST FLOOR ELEV. 80.00m

NO.	ISSUED FOR	DATE
1	ISSUED FOR PERMIT	2016-01-18
2	REVISION	2016-01-18
3	REVISION	2016-01-18
4	REVISION	2016-01-18
5	REVISION	2016-01-18
6	REVISION	2016-01-18
7	REVISION	2016-01-18
8	REVISION	2016-01-18
9	REVISION	2016-01-18
10	REVISION	2016-01-18
11	REVISION	2016-01-18
12	REVISION	2016-01-18
13	REVISION	2016-01-18
14	REVISION	2016-01-18
15	REVISION	2016-01-18

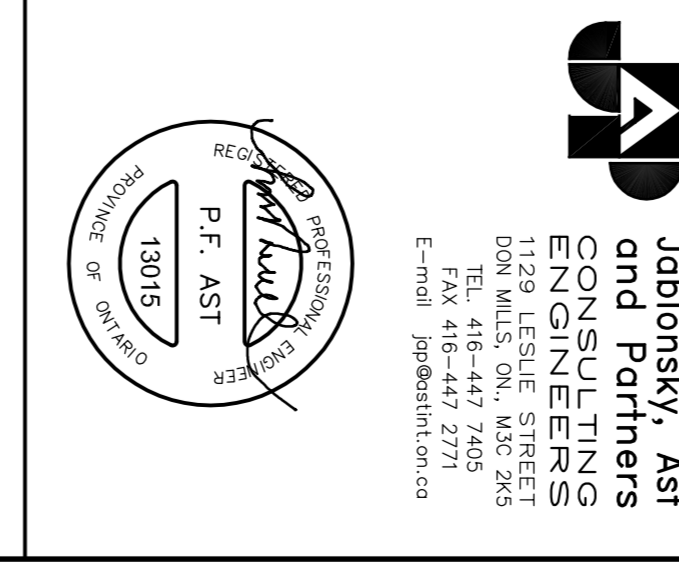

Johlborsky, Ash & Partners
ENGINEERS
200 W. MILLS AVE., SUITE 205
TORONTO, ONT. M6P 2E5
Tel: 416-441-2777
Fax: 416-441-2778
E-mail: johlborsky@jap.ca