


9TH FLOOR FRAMING PLAN
SCALE 1:100

- TOP OF SLAB IS AT ELEVATION AS SHOWN ON ARCH. DRAWINGS EXCEPT AS CROSSED AND NOTED ON PLAN.
- CONCRETE STRENGTH AT 28 DAYS SHALL BE:
FOR WALLS AND COLUMNS SEE SCHEDULE FOR EXIST. SLABS 33 MPa
FOR EXIST. SLABS 33 MPa
FOR BEAMS 35 MPa
CONCRETE CURED TO STRENGTH SHALL BE 33 MPa WITH 6% TO BE OBTAINED AS
- FLOOR SLABS ARE DESIGNED FOR FOLLOWING LOADING CONDITIONS:

	S.L.D.	L.L.
STAIRS & BALCONIES	0.50 KPa	4.50 KPa
LOOKERS & STORAGE *	1.50 KPa	4.50 KPa
RESIDENTIAL	1.50 KPa	1.9 KPa
TOILETS	1.50 KPa	2.40 KPa
TERMINALS	5.0 KPa	4.50 KPa

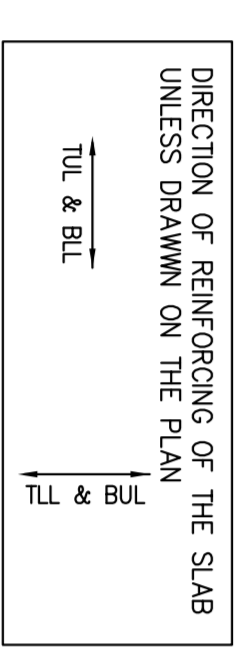

- MINIMUM YIELD STRESS FOR REINFORCING STEEL SHALL BE 400 MPa.
- TEMPERATURE REINFORCING FOR: 200 SLAB IS 100%.
- NO OPENINGS LARGER THAN 300mm x 300mm ARE ALLOWED IN SLAB OTHER THAN THOSE SHOWN ON DRAWINGS.
- SEE TYPICAL DETAILS ON DRAWINGS S-001 TO S-006.
- SEE GENERAL NOTES ON DRAWINGS S-001.
- REFER TO ARCH. DRAWINGS FOR SLOPES OF SLAB.
- FOR COLUMN & WALL SCHEDULE SET DRAWINGS S-001 TO S-006.
- CORRODATE BEAM DEPTH AT DOOR OPENINGS WITH ARCH. DRAWINGS.
- EXTEND TOP REIN. TO END OF BALCONIES/PERIMETERS.
- TOP BARS TERMINATING AT EDGE OF SLAB TO HAVE 180° HOOK.

ALEXANDRA PARK - BLOCK 11
TORONTO, ONTARIO

NO.	REVISION / COMMENTS	DATE
1	ISSUED FOR PERMIT	2014.03.04
2	REVISED FOR COMMENTS	2014.03.10
3	REVISED FOR COMMENTS	2014.03.10
4	REVISED FOR COMMENTS	2014.03.10
5	REVISED FOR COMMENTS	2014.03.10
6	REVISED FOR COMMENTS	2014.03.10
7	REVISED FOR COMMENTS	2014.03.10
8	REVISED FOR COMMENTS	2014.03.10
9	REVISED FOR COMMENTS	2014.03.10
10	REVISED FOR COMMENTS	2014.03.10
11	REVISED FOR COMMENTS	2014.03.10
12	REVISED FOR COMMENTS	2014.03.10
13	REVISED FOR COMMENTS	2014.03.10
14	REVISED FOR COMMENTS	2014.03.10
15	REVISED FOR COMMENTS	2014.03.10
16	REVISED FOR COMMENTS	2014.03.10

FIRST FLOOR ELEV. 80.00m

Johibsky, Asif
Civil Engineers
1111 BAYVIEW AVE. SUITE 200
SCARBOROUGH, ONTARIO M1B 2Y7
Tel: 416-441-2777
Fax: 416-441-2777
E-mail: johibsky@johibsky.com

P.F. ASST
Professional Engineer
No. 10007
Ontario