

10TH FLOOR FRAMING PLAN

SCALE: 1" = 100'

1. TOP OF SLAB IS AT ELEVATION AS SHOWN ON ARCH. DRAWINGS EXCEPT AS NOTED ON PLAN.
2. CONCRETE STRENGTH AT 28 DAYS SHALL BE: FOR WALLS AND COLUMNS SEE SCHEDULE FOR INTERIOR SLABS 25 MPa FOR BEAMS 30 MPa CONCRETE EXPOSED TO ELEMENTS SHALL BE 35 MPa WITH 6% TO BE ENTRAINED AIR.
3. FLOOR SLABS ARE DESIGNED FOR FOLLOWING LOADING CONDITIONS:

	S.L.D.	L.L.
STAIRS & BALCONIES	0.50 KPa	4.80 KPa
LOCKERS & STORAGE	1.50 KPa	4.80 KPa
RESIDENTIAL	1.50 KPa	2.40 KPa
TOILETS	1.50 KPa	4.80 KPa
TERRACES	5.0 KPa	4.80 KPa

DIRECTION OF REINFORCING OF THE SLAB UNLESS SHOWN ON THE PLAN

TL & BL
TR & BR

10TH FLOOR BEAM SCHEDULE ($f_c' = 35\text{MPa}$)


MARK	WIDTH	DEPTH	REINFORCEMENT		STIRRUPS		REMARKS
			BOTTOM CONT.	TOP CONT.	SIZE	EACH END	
BM-1	700	500	2-15T20	5-20	15	19A100, 69A200, 9A25	ADD 1-15HF
BM-2	700	500	2-15T20	5-20	15	19A100, 69A200, 9A25	ADD 1-15HF
BM-3	900	600	2-15T20	5-25	15	19A5, 9A70	ADD 1-15HF
BM-4	900	600	2-15T20	5-25	15	19A5, 9A70	ADD 1-15HF

Joblonsky, Asif
and Partners
ENGINEERS
 609 W. GERRARD ST. W. SUITE 205
 TORONTO, ONT. M5G 1S2
 Tel: 416-464-2727
 Fax: 416-464-2727
 E-mail: info@joblonsky.com

P.F. ASIF
 P. ENG.
 10007

FIRST FLOOR ELEV. 80.00m

NO.	REVISION	DATE
1	ISSUED FOR PERMIT	2014.03.10
2	REVISION	2014.03.10
3	REVISION	2014.03.10
4	REVISION	2014.03.10
5	REVISION	2014.03.10
6	REVISION	2014.03.10
7	REVISION	2014.03.10
8	REVISION	2014.03.10
9	REVISION	2014.03.10
10	REVISION	2014.03.10

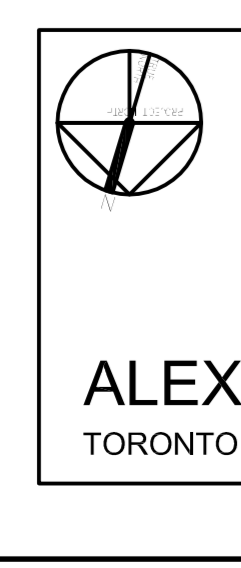

ALEXANDRA PARK - BLOCK 11
 TORONTO, ONTARIO

DATE: 11.00.14
 DRAWN BY: H.M.
 CHECKED BY: H.M.
 DATE: 11.00.14