


## PENTHOUSE FLOOR FRAMING PLAN

SCALE 1 : 100

1. TOP OF SLAB IS AT ELEVATION AS SHOWN ON ARCH. DRAWINGS EXCEPT AS CROSSED AND NOTED ON PLAN.
2. CONCRETE STRENGTH AT 28 DAYS SHALL BE:  
FOR WALLS AND COLUMNS ..... SEE SCHEDULE  
FOR EXT. SLABS ..... 35 MPa  
FOR INTERIOR SLABS ..... 25 MPa  
FOR BEAMS ..... 35 MPa
- CONCRETE EXPOSED TO ELEMENTS SHALL BE 35 MPa WITH 6% TO 8% ENTRAINED AIR.
4. MINIMUM YIELD STRESS FOR REINFORCING STEEL SHALL BE 400 MPa.
5. TEMPERATURE REINFORCING FOR : 200 SLAB IS 100S20,  
250 SLAB IS 100S40,  
300 SLAB IS 100S30.
6. NO OPENINGS LARGER THAN 300mm x 500mm ARE ALLOWED IN SLAB OTHER THAN THOSE SHOWN ON DRAWINGS.
7. SEE TYPICAL DETAILS ON DRAWINGS S-001 TO S-005.

\* 

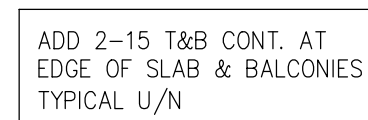

SCALE 1 : 100

1. TOP OF ROUGH SLAB IS 0mm BELOW FINISHED FLOOR EXCEPT AS CROSSED AND NOTED ON PLAN.
2. ROOF SLABS ARE DESIGNED FOR FOLLOWING LOADING CONDITIONS:

	S.I.D.	L.L.
1999-2000	1999-2000	1999-2000

3. CONCRETE STRENGTH AT 28 DAYS SHALL BE 30 MPa AND CONCRETE STRENGTH FOR EXPOSED CONCRETE IN BALCOES AND TERRACES SHALL BE 30 MPa AND HAVE 6% TO 8% ENTRAINED AIR.
4. MINIMUM YIELD STRESS FOR REINFORCING STEEL SHALL BE 400 MPa.
5. TEMPERATURE REINFORCING: 250 SLAB IS 150400
6. NO OPENINGS LARGER THAN 300mm x 300mm ARE ALLOWED IN SLAB OTHER THAN THOSE SHOWN ON DRAWINGS.
7. SEE ARCH. DRAWINGS FOR ROOF SLOPES.
8. SEE TYPICAL DETAILS ON DRAWINGS S-001 TO S-005.
9. SEE GENERAL NOTES ON DRAWING S-001.
10. FOR COLUMN & WALL SCHEDULE SEE DRAWINGS S-301 TO S-306
11. FOR SIZE, LOCATION AND EXTEND OF CURBS SEE ARCH. DRAWINGS.
12. FOR OPENINGS EXACT LOCATION & DIMENSION SEE ARCH. DWG'S & MECH. DWG'S.



no.	issued / revised	date:
1	ISSUED FOR PERMIT	2014-01
2	RE ISSUED FOR PERMIT	2014-01
3	ISSUED FOR FORMING TENDER	2014-06
4	CONSTRUCTION REVIEW	2014-12
5	RE ISSUED FOR PERMIT	2015-01
6	ISSUED FOR CONSTRUCTION	2015-03
7	UPDATED - IFC	2015-04
8	UPDATED - IFC	2015-05
9	ISSUED FOR I2-6	2015-01