


NOTES:
1. SURFACE EXIT FIXTURE OR EMERGENCY LIGHTING UNIT.
2. CEILING SUSPENSION SYSTEM.
3. CEILING TREATMENT.
4. CEILING SUSPENSION SYSTEM.
5. CEILING TREATMENT.
6. CEILING SUSPENSION SYSTEM HANGER.
7. THREADED BARE SUPPORT.
8. 19mm RIGID CONDUIT.
9. OUTLET BOX TO SUIT FIXTURE.
10. LATERAL SUPPORT WHERE CONDUIT EXCEEDS 1800mm.
11. ROOF DECK/FLOOR ASSEMBLY.

1 SURFACE EXIT FIXTURE




2 LUMINAIRE SUSPENSION DETAIL, T-BAR CEILING




NOTES:
1. ELECTRICAL CONTRACTOR SHALL COORDINATE WITH PROVIDENT ENERGY MANAGEMENT TO PROVIDE CT COMPARTMENT EACH SUITE DISTRIBUTION PANEL (SDP).
2. SPACE FOR QUADLOGIC PANELS TO BE SUPPLIED BY OTHERS AND INSTALLED BY DIVISION 16. TOTAL OF 9 PANELS ON EACH METERING FLOOR, REFER TO QUADLOGIC SHOP DRAWINGS.

3 TYPICAL ELECTRICAL CLOSET DETAIL




4 MOUNTING HEIGHT DETAIL OF EMERGENCY BATTERY PACK



NOTES:
1. POWER WIRING AND CONDUIT BY DIV. 16
2. MAGNETIC STARTERS BY DIV. 15 IF REQUIRED
3. POWER WIRING AND CONDUIT, SAFETY SWITCH BY DIV. 16
4. FAN BY DIV. 15
5. LINE VOLTAGE ACTUATOR BY DIV. 15
6. LINE VOLTAGE CONTROL WIRING AND CONDUIT BY DIV. 16
7. LINE VOLTAGE THERMOSTAT BY DIV. 15

5 EXHAUST FAN/MOTORIZED INTAKE DAMPER WIRING DIAGRAM

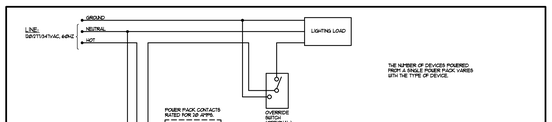


NOTES:
1. 3 OR LESS OCCUPANCY SENSORS IN 1 LIGHTING CIRCUIT

6 LIGHTING CONTROL BLOCK DIAGRAM




NOTES:
1. DIV. 16 TO PROVIDE EMPTY 1/2"EMT FOR LOW VOLTAGE WIRING BY FIREPLACE CONTRACTOR.

7 FIREPLACE CONNECTION DIAGRAM




8 DRUM DRIP - AT LOW POINT- DETAIL

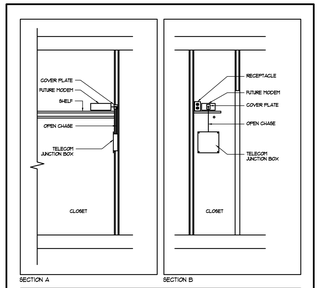


9 TELECOMMUNICATION BOX INSTALLATION DETAIL

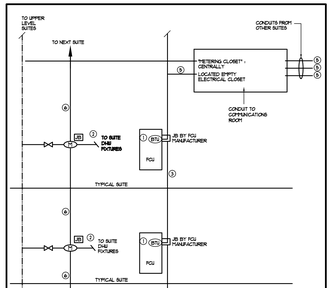


NOTES:
1. BTU METER INTEGRAL TO FAN COIL UNIT, INSTALLED BY FCU MANUFACTURER.
2. DOMESTIC HOT WATER METER LOCATED NEXT TO SUITE SHUT OFF VALVE. METER IS INSTALLED BY DIV. 15.
3. DIV. 16 TO SUPPLY AND INSTALL 1/2" EMT CONDUIT, DIV. 16 TO PULL SIGNAL WIRE. WIRE SUPPLIED BY OTHERS.
4. DIV. 16 TO SUPPLY AND INSTALL 1/2" IN-SLAB CONDUIT FROM WATER METER TO JB AT SUITE FAN COIL. DIV. 16 TO PULL SIGNAL WIRES. WIRE SUPPLIED BY OTHERS. FINAL CONNECTION TO METERS BY OTHERS.
5. DIV. 16 TO PROVIDE IN-SLAB CONDUIT AT MID-LEVEL FLOOR FROM VERTICAL RISERS TO CENTRAL METERING LOCATION.
6. DIV. 16 TO INSTALL 1/2" EMT CONDUIT TO CONNECT WATER METERS AT EVERY SUITE AS A DEDICATED RISER.
7. THIS DETAIL IS TYPICAL FOR BOTH LOFT AND MAIN TOWER SUITES.

10 TYPICAL SUITE WATER/BTU METERING DETAIL

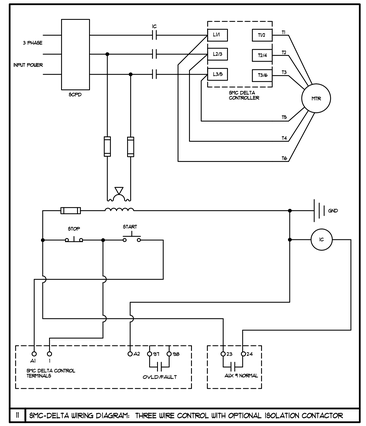


11 SMC-DELTA WIRING DIAGRAM. THREE WIRE CONTROL WITH OPTIONAL ISOLATION CONTACTOR

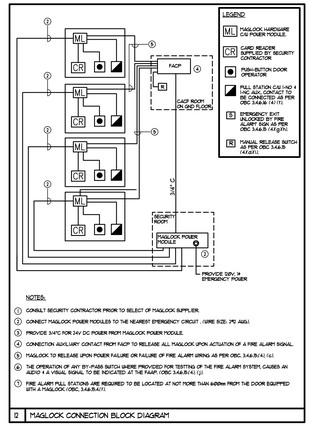


NOTES:
1. CONSULT SECURITY CONTRACTOR PRIOR TO SELECT OF MAGLOCK SUPPLIER.
2. CONNECT MAGLOCK POWER MODULES TO THE NEAREST EMERGENCY CIRCUIT. (WIRE SIZE: 2*C AWG).
3. PROVIDE 24VC FOR 24V DC POWER FROM MAGLOCK POWER MODULE.
4. CONNECTION AUXILIARY CONTACT FROM FACP TO RELEASE ALL MAGLOCKS UPON ACTUATION OF A FIRE ALARM SIGNAL.
5. MAGLOCK TO RELEASE UPON POWER FAILURE OR FAILURE OF FIRE ALARM WIRING AS PER OBC 3.4.6.8.(4) (6).
6. THE OPERATION OF ANY BY-PASS BUTTON (WHERE PROVIDED) FOR TESTING OF THE FIRE ALARM SYSTEM, CAUSES AN AUDIO + A VISUAL SIGNAL TO BE INDICATED AT THE FAAP (OBC 3.4.6.8.(4) (c).
7. FIRE ALARM PULL STATIONS ARE REQUIRED TO BE LOCATED AT NOT MORE THAN 6400mm FROM THE DOOR EQUIPPED WITH A MAGLOCK (OBC 3.4.6.(8.4.7)

12 MAGLOCK CONNECTION BLOCK DIAGRAM

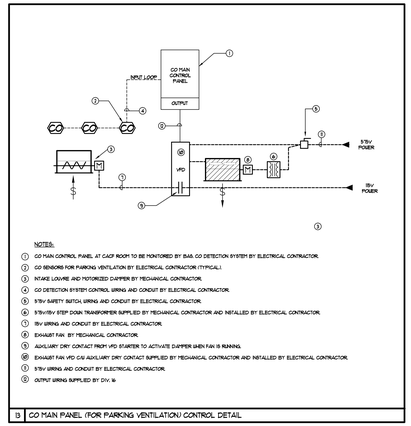


NOTES:
1. GO MAIN CONTROL PANEL AT CAGE ROOM TO BE MONITORED BY BAS. GO DETECTION SYSTEM BY ELECTRICAL CONTRACTOR.
2. GO SENSORS FOR PARKING VENTILATION BY ELECTRICAL CONTRACTOR (TYPICAL).
3. INTAKE LOUVRE AND MOTORIZED DAMPER BY MECHANICAL CONTRACTOR.
4. GO DETECTION SYSTEM CONTROL WIRING AND CONDUIT BY ELECTRICAL CONTRACTOR.
5. 575V SAFETY SWITCH WIRING AND CONDUIT BY ELECTRICAL CONTRACTOR.
6. 575V/115V STEP DOWN TRANSFORMER SUPPLIED BY MECHANICAL CONTRACTOR AND INSTALLED BY ELECTRICAL CONTRACTOR.
7. 115V WIRING AND CONDUIT BY ELECTRICAL CONTRACTOR.
8. EXHAUST FAN. BY MECHANICAL CONTRACTOR.
9. AUXILIARY DRY CONTACT FROM VFD STARTER TO ACTIVATE DAMPER WHEN FAN IS RUNNING.
10. EXHAUST FAN VFD C/W AUXILIARY DRY CONTACT SUPPLIED BY MECHANICAL CONTRACTOR AND INSTALLED BY ELECTRICAL CONTRACTOR.
11. 575V WIRING AND CONDUIT BY ELECTRICAL CONTRACTOR.
12. OUTPUT WIRING SUPPLIED BY DIV. 16

13 GO MAIN PANEL (FOR PARKING VENTILATION) CONTROL DETAIL




NOTES:
1. A RECEPTACLE IS PERMITTED TO BE INSTALLED WITHIN A 3m RADIUS OUTSIDE OF A LAUNDRY CLOSET.

14 RECEPTACLE FOR LAUNDRY CLOSET



NOTES:
1. HEATER BY DIV. 15
2. POWER WIRING, CONDUIT, AND SAFETY SWITCH BY DIV. 16
3. LOW VOLTAGE CONTROL WIRING BY DIV. 15 CONDUIT BY DIV. 16
4. LOW VOLTAGE THERMOSTAT BY DIV. 15

15 UNIT HEATER WIRING DIAGRAM

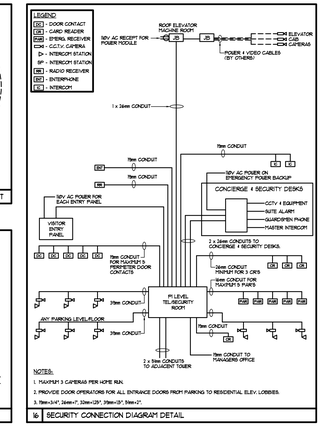


NOTES:
1. MAXIMUM 3 CAMERAS PER HOME RUN.
2. PROVIDE DOOR OPERATORS FOR ALL ENTRANCE DOORS FROM PARKING TO RESIDENTIAL ELEV. LOBBIES.
3. 78mm=3-1/4", 26mm=1", 32mm=1-1/4", 39mm=1-1/2", 51mm=2".

16 SECURITY CONNECTION DIAGRAM DETAIL

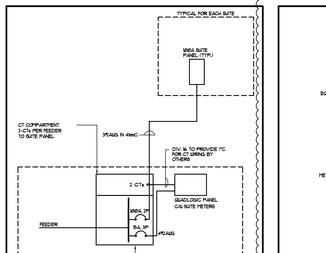


NOTES:
11. DIV. 16 TO PROVIDE AN INTEGRATED PANEL CONSISTING OF A REGULAR PANELBOARD AND A CT COMPARTMENT.
22. DIV. 16 TO PURCHASE 3CTS PER SUITE FROM PROVIDENT AND INSTALL AT CT COMPARTMENT AT SUITE FEEDER CABLES. DIV. 16 TO CONNECT CTS TO QUADLOGIC PANELS.
33. 3/4" CONDUIT BY DIV. 16, WIRING BY OTHERS.

17 QUADLOGIC INTERCOM BLOCK DIAGRAM

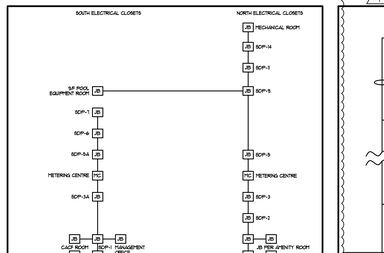


NOTES:
1. RISER CONDUITS SHALL BE 1"C (TYPICAL).
2. BRANCH CONDUITS SHALL BE 1/2"C (TYPICAL) UNLESS OTHERWISE NOTED.
3. ALL BOXES/COVERS TO BE MARKED "EMS".
4. FLOORS CONTAINING "HC" METERING CENTRES" REQUIRE 120V POWER.
4. PANEL JB: FOR "HOPE" SUITE DISTRIBUTION PANELS (FROM THE BOTTOM) REQUIRE 120V POWER (ACTUAL LOCATION OF METERING CENTRE "HC" TO BE DETERMINED BY ELECTRICIAN. LOWEST POSSIBLE FLOOR)

18 METERING & EMS RISER DIAGRAM




NOTES:

19 BISORTER




20 MOTOR DRIVE AND STARTER CONNECTION, DIVISION OF RESPONSIBILITIES

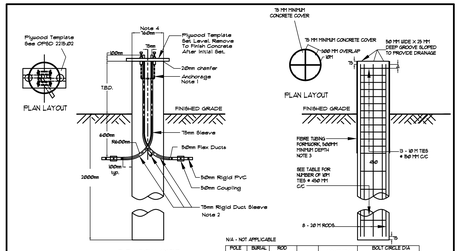


NOTES:
1. FOR ANCHORAGE ASSEMBLY SEE OPSD 228.02
2. MINIMUM OF TWO SLEEVES REQUIRED FOR EACH CONCRETE FOOTING. THREE SLEEVES AS SPECIFIED.
3. REMOVE FORMWORK ABOVE FINISHED GRADE AFTER INITIAL SET.
4. 19 MM = #6M, 29 MM = #9M
FOR POLE MOUNTING DETAILS SEE OPSD 2310.01.
ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN.

| POLE LENGTH | BURIED DEPTH | ROD LENGTH | A | NO. OF 15M BARS AND TIES c/c | BOLT CIRCLE DIA. FOR METAL POLES ALUMINUM | STEEL |
|---|---|---|---|---|---|---|
| H | m | m | mm | | | |
| 9m | 1.5 | 3.00 | 600 | 3 | N/A | 445 |
| 9.5 | 1.5 | 3.00 | 600 | 3 | N/A | 445 |
| 10 | 1.65 | 3.30 | 600 | 3 | N/A | 445 |
| 8.5 | 1.65 | 3.30 | 600 | 3 | N/A | 445 |
| 9.5 | 1.65 | 3.30 | 0 | 4 | 486 | N/A |
| 10.5 | 1.65 | 3.45 | 600 | 4 | 486 | N/A |
| 11.0 | 1.75 | 3.60 | 750 | 4 | 486 | N/A |
| 11.5 | 1.90 | 3.75 | 0 | 4 | 486 | N/A |
| 12 | 1.85 | 3.90 | 600 | 5 | 486 | N/A |

21 RAISED CONCRETE FOOTING FOR BASE MOUNTED LIGHTING POLES (REFER TO OPSD 2300.01 FOR MORE INFORMATION) (REFER TO STRUCTURAL AND ARCHITECTURAL DETAILS PRIOR TO INSTALLING POLE BASES) (THIS DETAIL IS FOR REFERENCE ONLY)




NOTES:
1. DIV. 16 TO PROVIDE A COMPLETE TURN-KEY SYSTEM INCLUDING ALL EQUIPMENT, DETECTORS, 24V + LOW VOLTAGE WIRING, AS WELL AS TESTING AND COMMISSIONING.
2. DIVIDE GARAGE INTO 1 ZONE PER FLOOR.
3. POWER SUPPLY COULD BE EITHER 24V AC OR 24V DC.
4. NUMBER OF ZONES CAN BE SETUP AND EXTENT THROUGH PROGRAMMING AT THE CO CONTROL PANEL.

22 CO SYSTEM CONDUIT CONNECTION DIAGRAM




NOTE:
ALL CABLES TO BE DISTRIBUTED EVENLY THROUGHOUT SPACE FOR.

24 FLOOR WARMING SCHEMATIC DIAGRAM DETAIL




NOTES:
1. CONNECT LIGHTING FIXTURE AND GFI WATERPROOF RECEPTACLE TO DEDICATED EMERGENCY POWER CCT.

26 TYPICAL ELEVATOR PIT DETAIL




23 OCCUPANCY SENSOR CONNECTION DIAGRAM

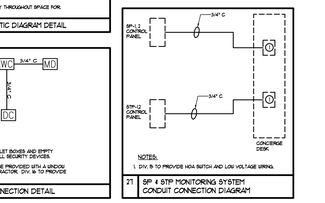


NOTES:
1. DIV. 16 TO PROVIDE ROUGH-IN OUTLET BOXES AND EMPTY CONDUITS C/W PULLSTRINGS FOR ALL SECURITY DEVICES.
2. EVERY OTHERABLE WINDOW IS TO BE PROVIDED WITH A WINDOW CONTACT BY SECURITY CONTRACTOR. DIV. 16 TO PROVIDE ROUGH-IN OUTLET BOX.

25 IN-SUITE SECURITY CONNECTION DETAIL




NOTES:
1. DIV. 16 TO PROVIDE N/A SWITCH AND LOW VOLTAGE WIRING.

27 6P + 6TP MONITORING SYSTEM CONDUIT CONNECTION DIAGRAM

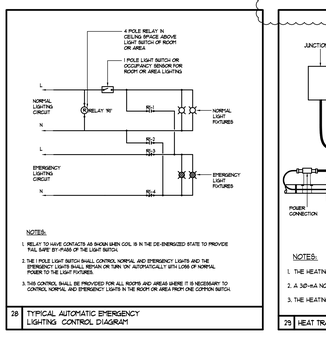


NOTES:
1. RELAY TO HAVE CONTACTS AS SHOWN (WHEN COIL IS IN THE DE-ENERGIZED STATE TO PROVIDE FULL SUITE BY-PASS OF THE LIGHT SWITCH.
2. THE 1 POLE LIGHT SWITCH SHALL CONTROL NORMAL AND EMERGENCY LIGHTS AND THE EMERGENCY LIGHTS SHALL REMAIN ON "ON" AUTOMATICALLY WITH LOSS OF NORMAL POWER TO THE LIGHT FIXTURES.
3. TWO CONTROL SHALL BE PROVIDED FOR ALL ROOMS AND AREAS WHERE IT IS NECESSARY TO CONTROL NORMAL AND EMERGENCY LIGHTS IN THE ROOM OR AREA FROM ONE COMMON SWITCH.

28 TYPICAL AUTOMATIC EMERGENCY LIGHTING CONTROL DIAGRAM

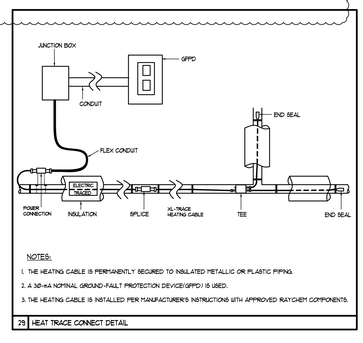


NOTES:
1. THE HEATING CABLE IS PERMANENTLY SECURED TO INSULATED METALLIC OR PLASTIC PIPING.
2. A 30-mA NOMINAL GROUND-FAULT PROTECTION DEVICE(GFPD) IS USED.
3. THE HEATING CABLE IS INSTALLED PER MANUFACTURER'S INSTRUCTIONS WITH APPROVED RAYCHEM COMPONENTS.

29 HEAT TRACE CONNECT DETAIL

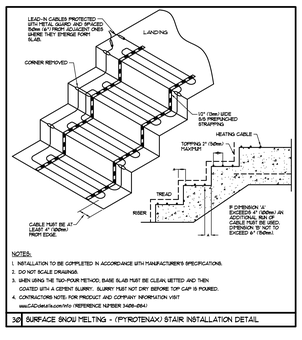


NOTES:
1. INSTALLATION TO BE COMPLETED IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS.
2. DO NOT SCALE DRAWINGS.
3. WHEN USING THE TWO-POUR METHOD, BASE SLAB MUST BE CLEAN, WETTED AND THEN COATED WITH A CEMENT SLURRY. SLURRY MUST NOT DRY BEFORE TOP CAP IS POURED.
4. CONTRACTORS NOTE: FOR PRODUCT AND COMPANY INFORMATION VISIT www.CADdetails.com/nhs (REFERENCE NUMBER 3426-0841)

30 SURFACE SNOW MELTING - (PYROTENAX) STAIR INSTALLATION DETAIL

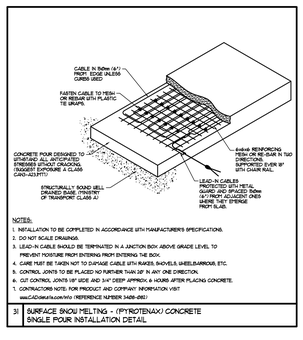


NOTES:
1. INSTALLATION TO BE COMPLETED IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS.
2. DO NOT SCALE DRAWINGS.
3. LEAD-IN CABLE SHALL BE TERMINATED IN A JUNCTION BOX ABOVE GRADE LEVEL TO PREVENT MOISTURE FROM ENTERING FROM ENTERING THE BOX.
4. CARE MUST BE TAKEN NOT TO DAMAGE CABLE WITH RAKES, SHOVELS, WHEELBARROWS, ETC.
5. CONTROL JOINTS TO BE PLACED NO FURTHER THAN 20' IN ANY ONE DIRECTION.
6. CUT CONTROL JOINTS 1/8" WIDE AND 3/4" DEEP APPROX 6 HOURS AFTER PLACING CONCRETE.
7. CONTRACTORS NOTE: FOR PRODUCT AND COMPANY INFORMATION VISIT www.CADdetails.com/nhs (REFERENCE NUMBER 3426-0841)

31 SURFACE SNOW MELTING - (PYROTENAX) CONCRETE SINGLE POUR INSTALLATION DETAIL

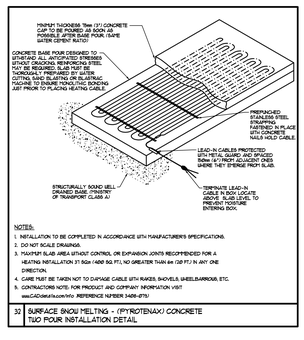


NOTES:
1. INSTALLATION TO BE COMPLETED IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS.
2. DO NOT SCALE DRAWINGS.
3. MAXIMUM SLAB AREA WITHOUT CONTROL OR EXPANSION JOINTS RECOMMENDED FOR A HEATING INSTALLATION 21.5Qm (400 SQ. FT.), NO GREATER THAN 6m (20 FT.) IN ANY ONE DIRECTION.
4. CARE MUST BE TAKEN NOT TO DAMAGE CABLE WITH RAKES, SHOVELS, WHEELBARROWS, ETC.
5. CONTRACTORS NOTE: FOR PRODUCT AND COMPANY INFORMATION VISIT www.CADdetails.com/nhs (REFERENCE NUMBER 3426-0775)

32 SURFACE SNOW MELTING - (PYROTENAX) CONCRETE TWO POUR INSTALLATION DETAIL

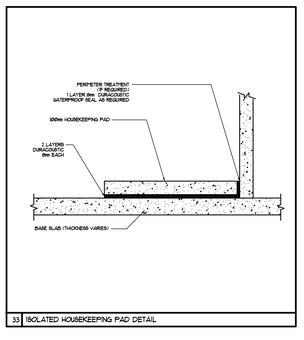


33 ISOLATED HOUSEKEEPING PAD DETAIL

## ELECTRICAL LEGEND

### LIGHTING

| | |
|---|---|
| | FLUORESCENT LIGHT FIXTURE TYPE AS INDICATED |
| | NIGHT LIGHT OR LIGHT CONNECTED TO EMERGENCY POWER. |
| | CEILING MOUNTED/WALL MOUNTED LIGHT FIXTURE, NSCRIBED LETTER DENOTES TYPE |
| | POLE MOUNTED LIGHT FIXTURE, NSCRIBED LETTER DENOTES TYPE |
| | CAPPED CEILING LIGHT OUTLET |
| | TRACK LIGHT |
| | STRIP LIGHT |
| | UNDER CABINET FLUORESCENT LIGHT FIXTURE |
| | CEILING MOUNTED/WALL MOUNTED EXIT SIGN |
| | SINGLE/DUAL EMERGENCY LAMP REMOTE HEAD |
| | EMERGENCY BATTERY PACK |
| PIP | OCCUPANCY SENSOR POWER PACKS |
| S / S1 / S2 / S3, 5P, 1D | SINGLE/TWO/THREE POLE, SINGLE/TWO/THREE THROW TOGGLE SWITCH RESPECTIVELY, ('3','4','P','D' DENOTES 3-WAY,4-WAY,PILOT LIGHT, DIFFERENT ENTERED LIGHT RESPECTIVELY) |
| MS | MASTER LIGHTING SHUT-OFF SWITCH |
| MS | SENSOR WALL SWITCH PIR, SELF POWERED |
| OS | OCCUPANCY SENSOR, CEILING MOUNTED |

### POWER

| | |
|---|---|
| | REGULAR DUPLEX RECEPTACLE |
| | DUPLEX RECEPTACLE, GROUND FAULT INTERRUPT |
| | 5-20R T-SLOT DUPLEX RECEPTACLE |
| | SINGLE RECEPTACLE, TYPE AND CONFIGURATION AS SPECIFIED FOR DRYER |
| | CONNECTION FOR OVEN/COOKTOP |
| | ABOVE COUNTER DEVICE |
| | CEILING MOUNTED DEVICES |
| | FLOOR MOUNTED DEVICES |
| DS | DISCONNECT SWITCH, NON-FUSED |
| DS | DISCONNECT SWITCH, FUSED |
| CB | COMBINATION STARTER |
| | FRACTIONAL HOTORFAN DIRECT CONNECTION |
| | DIRECT CONNECTION, SINGLE PHASE |
| | DIRECT CONNECTION, THREE PHASE |
| T | THERMOSTAT |
| DS | DRYER SENSOR |
| | HEAT TRACE |
| EHTR | ELECTRICAL HEATER |
| EP / AC | ELECTRICAL PANEL / SECURITY PANEL |

### TELECOMMUNICATION

| | |
|---|---|
| | TV/CABLE OUTLET |
| | TELEPHONE OUTLET |
| TP | TELEPHONE/CABLE (MULTI-PORT OUTLET) |
| | DATA OUTLET |
| | DATA/TELEPHONE OUTLET |
| CB | N SUITE TELECOMM. BOX C/W RECEPTACLE |
| LP | LIFT LOCATION |
| VC | VIDEO INTERCOM |
| RR | RADIO RECEIVER |

### SECURITY

| | |
|---|---|
| IC / IENT | INTERCOM / ENTERPHONE |
| CC | INTERCOM WITH CAMERA |
| PBI / PAB | PANIC BUTTON