


GENERAL NOTES:

1) THIS CONTRACTOR TO INSTALL FIRE DAMPER FOR DUCTWORK PENETRATING FIRE RATED WALLS, FLOOR SLAB, ETC.

2) FRESH AIR SUPPLY DUCT TO BE c/w 25MM INTERNAL ACOUSTIC LINING FROM AHU TO AIR SHAFT AND UP THREE FLOORS.

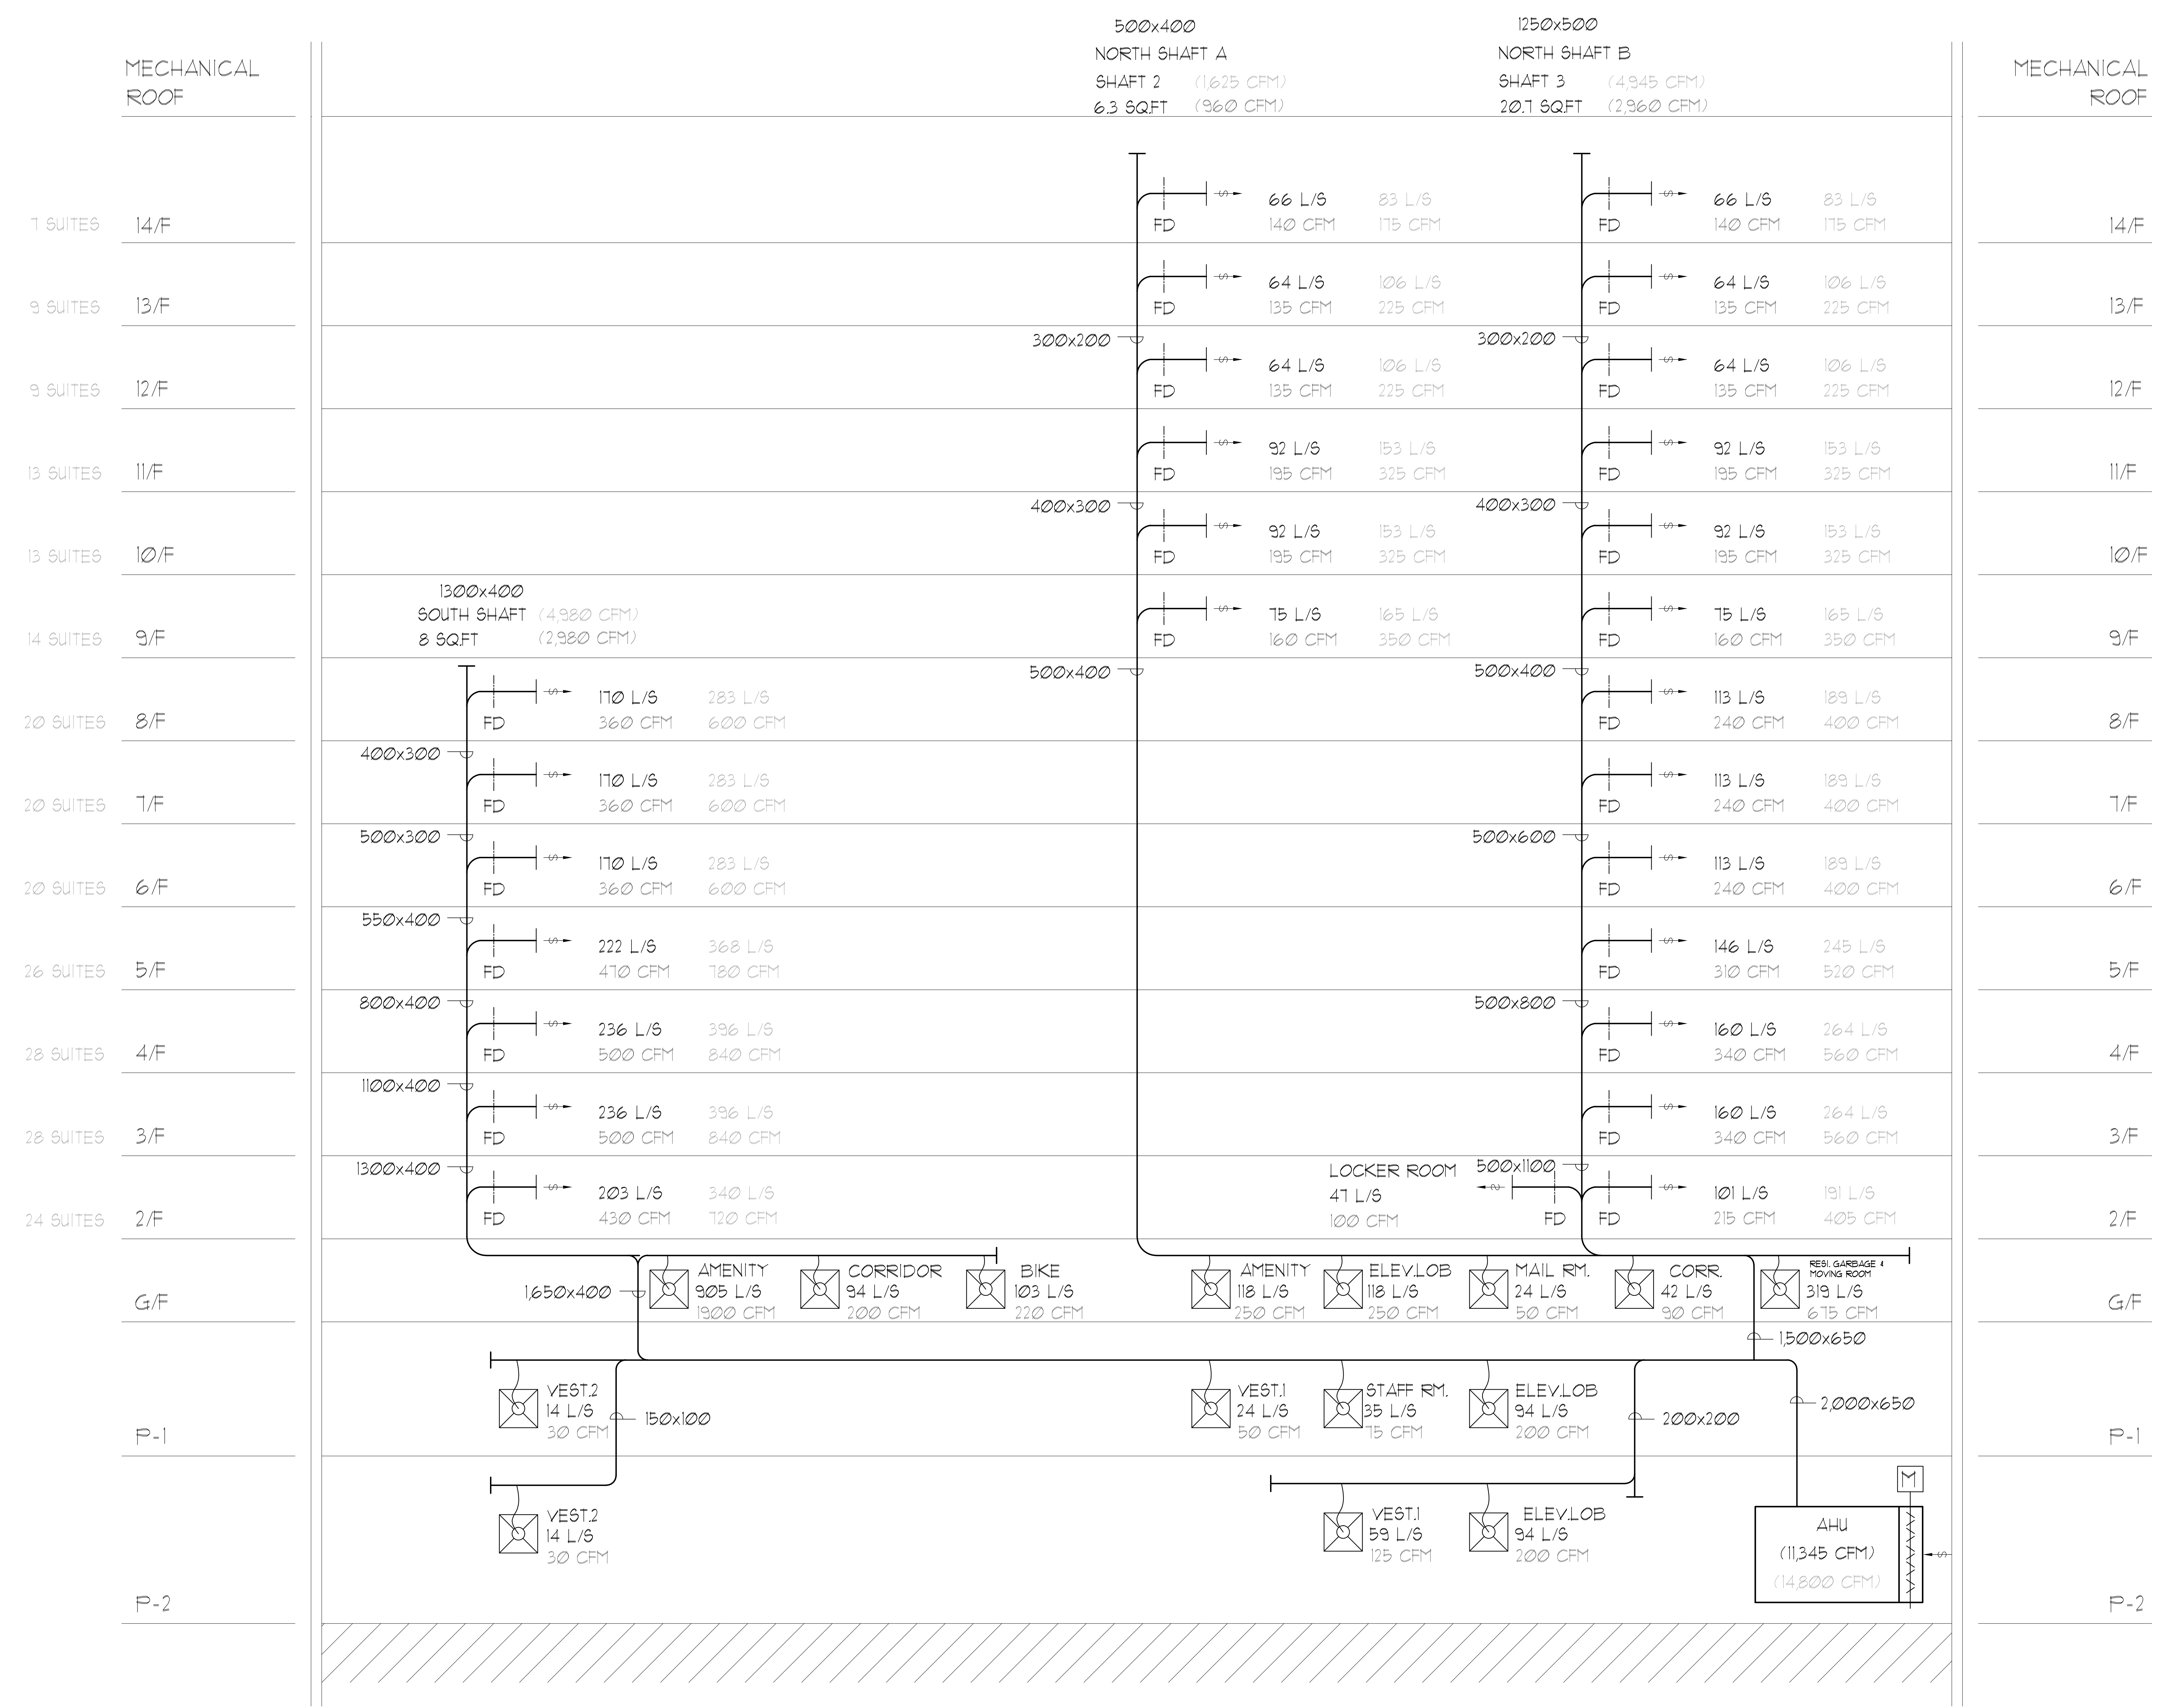


Drawing name: \CAD\DWG\General\151313 - Mechanical\151313 - PRESSURIZATION VENTILATION RIGER DIAGRAM.dwg Plot: Sep 09, 2014 - 9:13am

NO.	DATE	BY	DESCRIPTION

REVISIONS

CONTRACTOR MUST CHECK AND VERIFY ALL DIMENSIONS AND CONDITIONS ON THE JOB AND REPORT DISCREPANCIES TO THE ENGINEER BEFORE PROCEEDING WITH THE WORK. THIS DRAWING IS THE PROPERTY OF THE ENGINEER AND NOT TO BE REPRODUCED FROM COMPLETION OF THE WORK.

DRAWINGS ARE NOT TO BE SCALED

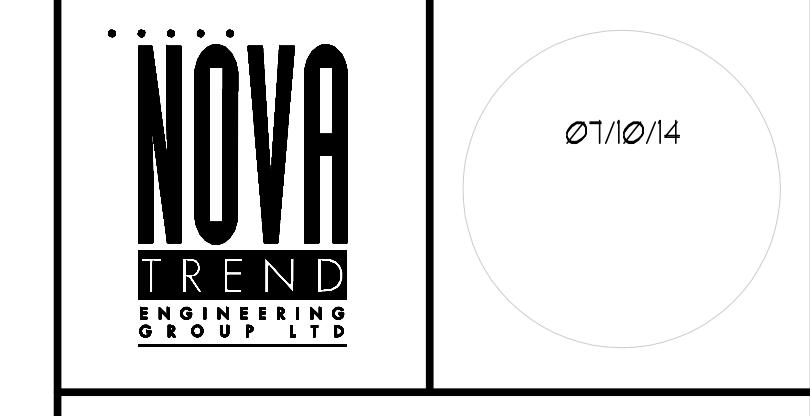

DRAWING TITLE PRESSURIZATION/VENTILATION RIGER DIAGRAM			
PROJECT TITLE G.G. ALEXANDRA PARK BLOCK II			
38 CAMERON STREET TORONTO ONTARIO			
DESIGNED BY G.S.	CHECKED BY E.P.	SCALE N.T.S.	DATE FEB, 13
PROJECT NUMBER 1313		DRAWING NUMBER M-31	
		OF 43	