GENERAL NOTES:

1) THIS CONTRACTOR TO INSTALL FIRE DAMPER FOR DUCTWORK PENETRATING FIRE RATED WALLS, FLOOR SLAB, ETC.

2) FRESH AIR SUPPLY DUCT TO BE c/w 25MM INTERNAL ACOUSTIC LINING FROM AHU TO AIR SHAFT AND UP THREE FLOORS.

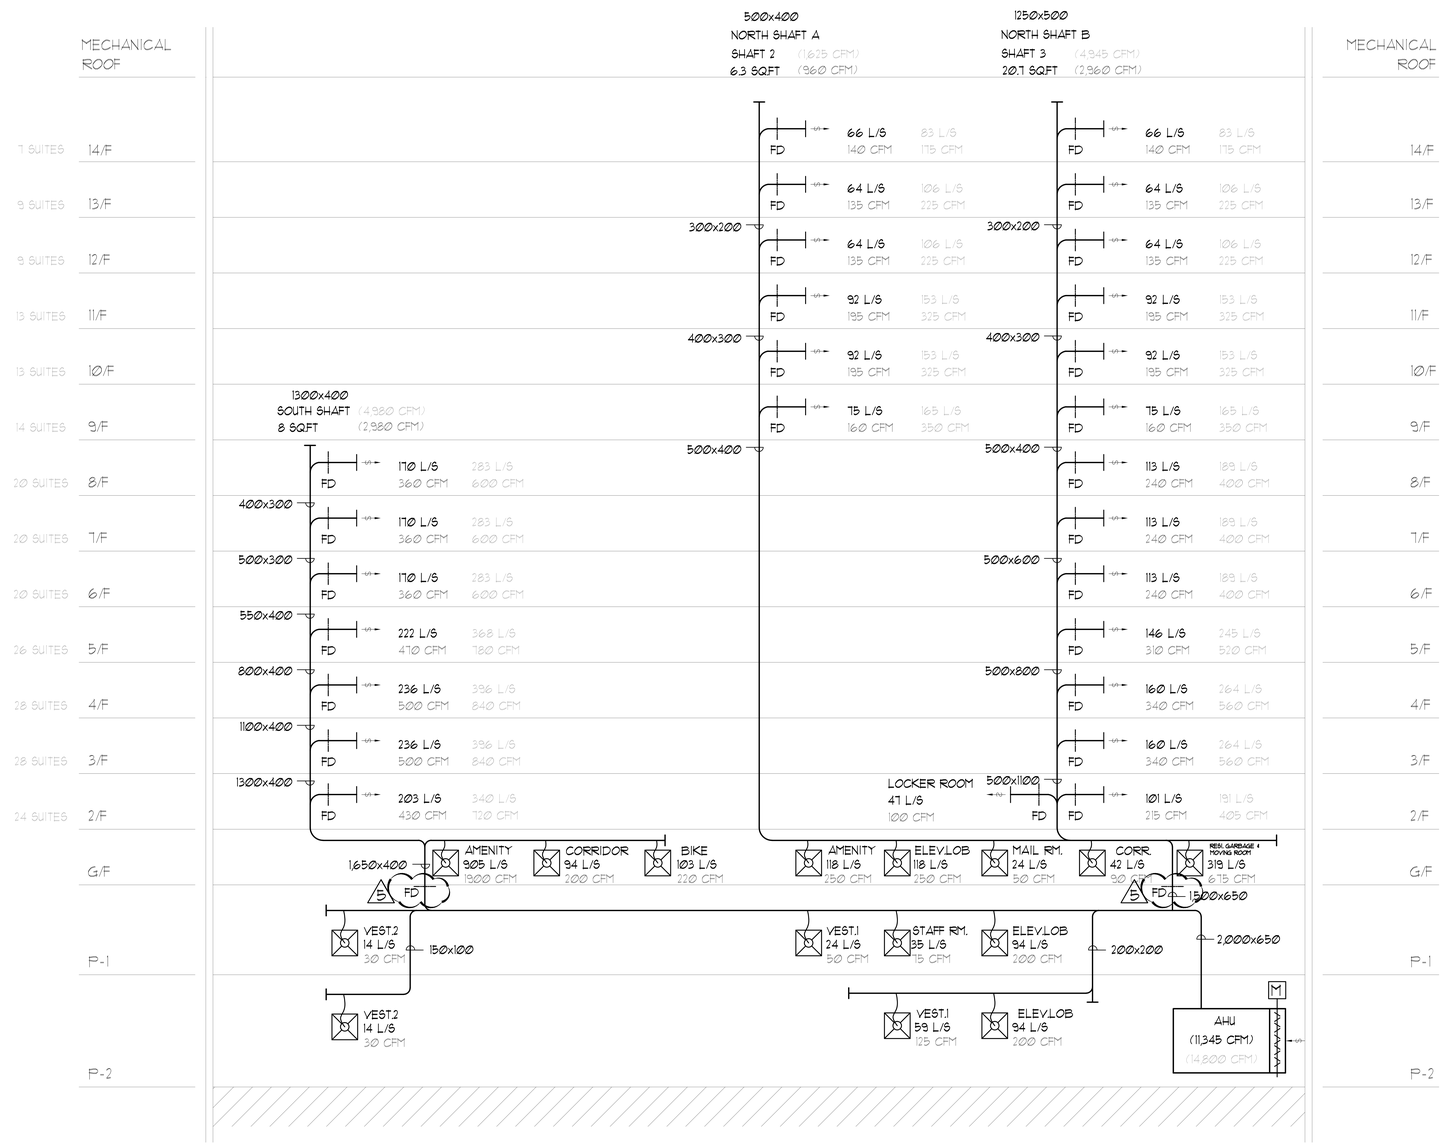

DATE	NO.	DESCRIPTION	BY
2015/05	5	ISSUED FOR SITE INSTRUCTION #1-4	E.P.
2014/11/18	4	ISSUED FOR CITY COMMENTS	E.P.
2013/04	3	ISSUED FOR TENDER	E.P.
2012/08/14	2	RE-ISSUED FOR PERMIT	E.P.
2012/07/04	1	ISSUED FOR PERMIT	E.P.

MARK VOID ALL PRINTS DATED PREVIOUS TO FINAL DATE ABOVE

REVISIONS

CONTRACTOR MUST CHECK AND VERIFY ALL DIMENSIONS AND CONDITIONS ON THE JOB AND REPORT ERRORS/FAULTS TO THE ENGINEERS BEFORE PROCEEDING WITH THE WORK. THIS DRAWING IS THE PROPERTY OF THE ENGINEERS AND MUST BE RETURNED UPON COMPLETION OF THE WORK.

DRAWINGS ARE NOT TO BE SCALED

NOVA TREND ENGINEERING GROUP LTD.

178 West Beaver Creek Road, Unit 31
Richmond Hill, Ontario L4B 3M1
Tel: 905 882-5445
Fax: 905 882-5447

DRAWING TITLE:
PRESSURIZATION/VENTILATION RISER DIAGRAM

PROJECT TITLE:
SQ ALEXANDRA PARK
BLOCK 11
38 CAMERON STREET
TORONTO ONTARIO

DRAWN BY:	CHECKED BY:	SCALE:
G.B.	E.P.	N.T.S.
DATE: FEB. 13	PROJECT NUMBER: 1313	DRAWING NUMBER: M-37 OF 43